



# Aspira<sup>®</sup>

A REVERSIBLE, NON-COMBUSTIBLE,  
ALUMINIUM DECKING SYSTEM



## Consolidated test reports and certifications

Edition: Two  
Date: May 2026

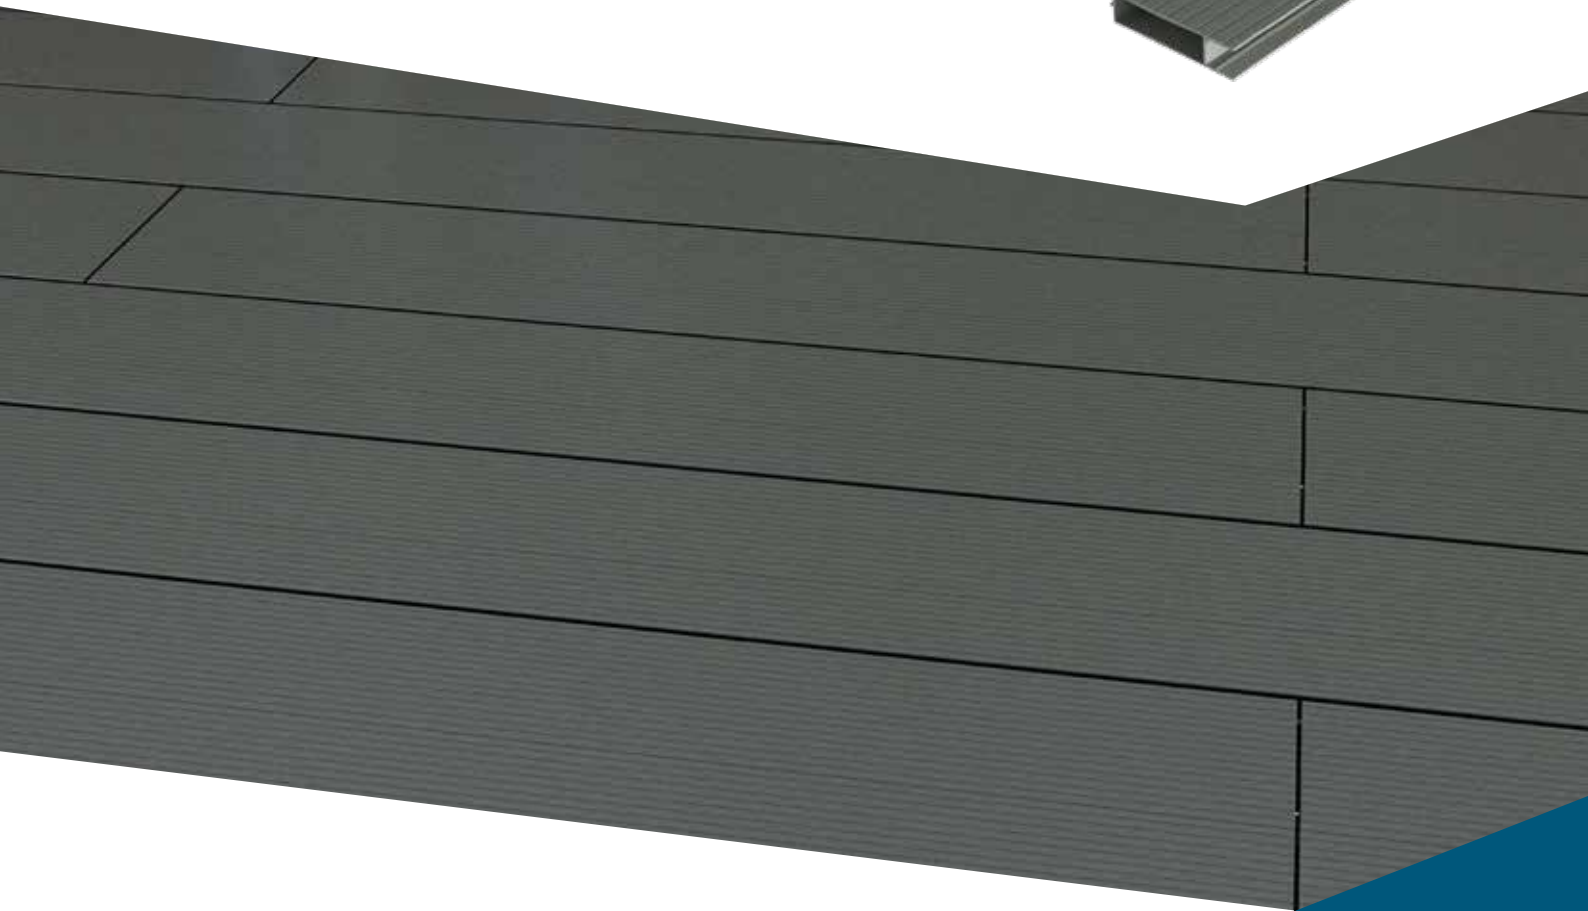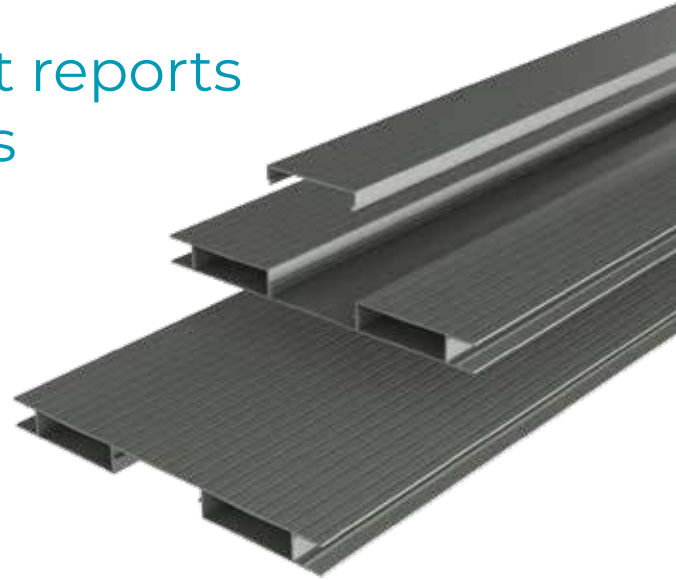



## Introduction

A reversible, non-combustible, aluminium decking system designed to enhance balconies and terraces, available in a range of standard finishes and compatible with the full range of support systems from MyDek for fast and accurate installation.

The reversible board is suitable for fixing onto steel or aluminium subframe, whilst the wider board format reduces the number of fixings required and speeds up installation.

## Index

1.0	Reaction to Fire Classification Report .....	4
2.0	BS EN 13823:2020+A1:2022 Test Report .....	16

For further information:

**T: +44 (0)3300 94 94 11**

**E: [sales@mydek.com](mailto:sales@mydek.com)**

**[mydek.com](http://mydek.com)**



# 1.0 Reaction to Fire Classification Report

System Laboratories UK LTD  
Classification Report

Classification of reaction to fire performance of  
construction products and building elements in  
accordance with BS EN 13501-1:2018



Report No.: 1369-D



**System Laboratories UK LTD**  
**Classification Report**  
**Classification of reaction to fire**  
**performance of construction products and**  
**building elements in accordance with BS**  
**EN 13501-1:2018**

System Laboratories UK  
LTD  
Unit 13  
Apex Park  
Leighton Road  
Leighton Buzzard  
LU7 3RE  
United Kingdom

Report Number 1369  
Issue D  
Prepared for MyDek Ltd.  
Date 05/05/2026

Issue	Date	Notes
A	13/02/2025	First issue
B	26/01/2026	Update for additional profile and updated worst performing results
C	24/04/2026	Extension to all colours
D	11/05/2026	Updated extension of scope





Report No.: 1369-D


---

*Prepared by*

---

Name                      A Melton

Position                  Laboratory Technician

Signature                 

---


*Authorised by*

---

Name                      A Gitarts

Position                  Laboratory Manager

Date                        11/05/2026

Signature                 

This report is made on behalf of System Laboratories UK LTD and may only be distributed in its entirety, without amendment, and with attribution to System Laboratories UK LTD to the extent permitted by the terms and conditions of the contract. Test results relate only to the specimens tested. System Laboratories UK LTD has no responsibility for the design, materials, workmanship or performance of the product or specimens tested. This report does not constitute an approval, certification or endorsement of the product tested and no such claims should be made on websites, marketing materials, etc. Any reference to the results contained in this report should be accompanied by a copy of the full report, or a link to a copy of the full report.

System Laboratories UK LTD's liability in respect of this report and reliance thereupon shall be as per the terms and conditions of contract with the client and System Laboratories UK LTD shall have no liability to third parties to the extent permitted in law.



For further information:

T: +44 (0)3300 94 94 11

E: [sales@mydek.com](mailto:sales@mydek.com)

[mydek.com](http://mydek.com)



Report No.: 1369-D

## Contents

1.	Introduction	4
2.	Details of classified product	5
2.1.	General	5
2.2.	Traceability	5
2.3.	Sample details	5
2.4.	Detailed product description	6
3.	Reports and results in support of this classification	7
3.1.	Reports	7
3.2.	Results	8
4.	Classification and field of application	9
4.1.	Reference of classification	9
4.2.	Classification	9
4.3.	Field of application	9
5.	Limitations	9
6.	References	10





Report No.: 1369-D

## 1. Introduction

This classification report defines the classification assigned to Aspira Reversible Decking Board and Innova Decking/Soffit Board, in accordance with the procedures given in BS EN 13501-1: 2018.

## CLASSIFICATION OF REACTION TO FIRE IN ACCORDANCE WITH BS EN 13501-1: 2018

Sponsor:	MyDek Ltd.
Prepared for:	MyDek Ltd.
Place of manufacture:	The sponsor has requested to keep this confidential, however System Laboratories holds all the relevant data
CAB Number:	N/A
Classification report No.:	1369-D
Date of issue	11/05/2026

This classification report may only be used or reproduced in its entirety.



For further information:

T: +44 (0)3300 94 94 11

E: [sales@mydek.com](mailto:sales@mydek.com)

[mydek.com](http://mydek.com)



Report No.: 1369-D

## 2. Details of classified product

### 2.1. General

Classification according to BS EN 13501-1:2018 of Aspira Reversible Decking Board and Innova Decking/Soffit Board.

### 2.2. Traceability

The test sample was supplied by the sponsor. System Laboratories UK LTD was not involved in the sampling process and therefore cannot comment upon the relationship between the samples supplied for the test and the products supplied to the market.

### 2.3. Sample details

Test sponsor	MyDek Ltd. 11 Arkwright Road Reading RG2 0LU UK
Place of manufacture	The sponsor has requested to keep this confidential, however System Laboratories holds all the relevant data
Trade name	Aspira Reversible Decking Board and Innova Decking/Soffit Board
Sample description (as provided by sponsor)	Powder coated Aspira aluminium decking 20 x 244mm reversible board mounted on 32mm BoxRail substrate
	<b>Product data (as provided by sponsor)</b>
Generic type of product	Powder coated aluminium decking
Thickness	20 mm - Nominal & 2 mm Aluminium Thickness / 140 microns - Max for PP1
Density of core	2710 kg/m <sup>3</sup>
Mass per unit area	10.84 kg <sup>2</sup> - Aluminium (Calculated by laboratory)
Application rate of PPC	Maximum - 0.1923 kg/m <sup>2</sup>
Colour	Interpon D2525 Structura RAL 3004 (Red)
Test face	Either side





Report No.: 1369-D

Flame retardant added, or  
organic content limited  
during production N/A

**Substrate and ventilation conditioned**

Substrate No substrate tested  
Air gap 32 mm minimum

**2.4. Detailed product description**

The product is configured as detailed below, front to back.

PPC	Type of product/layer	PPC
	Product/layer reference	PPC
	Thickness	140 microns (maximum)
	Application rate	0.1923 kg/m <sup>2</sup> (maximum)
	Colour	Interpon D2525 Structura RAL 3004 (Red)
	Construction form	PPC applied to 2 mm aluminium
Reversible Aluminium Boards	Type of product/layer	Reversible aluminium boards
	Product/layer reference	Reversible aluminium boards
	Thickness	20 x 244 mm
	Colour	Metallic
	Construction form	Reversible aluminium boards
Proprietary BoxRail	Type of product/layer	Proprietary BoxRail
	Product/layer reference	Proprietary BoxRail
	Thickness	32 mm minimum
	Colour	Metallic
	Construction form	BoxRail Frame



For further information:

T: +44 (0)3300 94 94 11

E: sales@mydek.com

mydek.com



Report No.: 1369-D

### 3. Reports and results in support of this classification

#### 3.1. Reports

Name of laboratory	Name of test sponsor	Test report No.	Test method/field of application
System Laboratories UK	MyDek Ltd.	1308-A	BS EN 13823:2020+A1:2022
Warringtonfire	MyDek Ltd.	530367 Version 1	EN ISO 1716:2018
System Laboratories UK	MyDek Ltd.	1967-A	BS EN 13823:2020+A1:2022
CSTB	AKZO NOBEL SAS	RA25-0066	NF EN 13501-1:2018
System Laboratories UK	MyDek Ltd.	2177-A	BS EN 13823:2020+A1:2022





Report No.: 1369-D

### 3.2. Results

Test method	Parameter	Number of tests	Results	
			Continuous parameter mean	Compliance with class A2-s1,d0
BS EN 13823:2020+A1:2022	FIGRA <sub>0,2</sub>	3	18.63 W/s	≤ 120 W/s <b>Compliant</b>
BS EN 13823:2020+A1:2022	THR <sub>600</sub>	3	0.75 MJ	≤ 7.5 MJ <b>Compliant</b>
BS EN 13823:2020+A1:2022	LFS	3	No spread to edge	No spread to edge <b>Compliant</b>
BS EN 13823:2020+A1:2022	SMOGRA	3	4.44 m <sup>2</sup> /s <sup>2</sup>	≤ 30 m <sup>2</sup> /s <sup>2</sup> <b>Compliant</b>
BS EN 13823:2020+A1:2022	TSP <sub>600</sub>	3	24.78 m <sup>2</sup>	≤ 50 m <sup>2</sup> <b>Compliant</b>
BS EN 13823:2020+A1:2022	Flaming Droplets	3	No flaming droplets	No flaming droplets <b>Compliant</b>
BS EN ISO 1716:2018 (b)	MJ/m <sup>2</sup>	3	0.1923 MJ/m <sup>2</sup>	≤ 4 MJ/m <sup>2</sup> <b>Compliant</b>
BS EN ISO 1716:2018 (e) Product is a whole	MJ/kg	3	0.7132 MJ/kg	≤ 3 MJ/kg <b>Compliant</b>

**Note:**

The aluminium was not tested in the EN ISO 1716:2018 due to clause 9.4.1 where metals are deemed to have a calorific value of 0.



For further information:

T: +44 (0)3300 94 94 11

E: sales@mydek.com

[mydek.com](http://mydek.com)



Report No.: 1369-D

## 4. Classification and field of application

### 4.1. Reference of classification

This classification has been carried out in accordance with BS EN 13501-1:2018.

### 4.2. Classification

The product Aspira Reversible Decking Board and Innova Decking/Soffit Board, in relation to reaction to fire behaviour is classified:

This classification report may only be used or reproduced in its entirety.

Fire behaviour	Smoke production	Flaming droplets
A2	s1	d0

Reaction to fire classification:	<b>A2-s1,d0</b>
----------------------------------	-----------------

### 4.3. Field of application

This classification is valid for the following product and mounting and fixing parameters:

Thickness	Aluminium - No variation allowed PPC - ≤ 120 microns
Colour	All colours
Density of core	No variation allowed
Mass per unit area	Aluminium - No variation allowed PPC - ≤ 0.1923 kg/m <sup>2</sup>
Composition/build up	Aspira Reversible Decking Board and Innova Decking/Soffit Board
Substrate	No variation allowed
Air gap	Metallic frame with minimum gap of 32mm

## 5. Limitations

This classification document does not represent type approval or certification of the product.

The laboratory has played no part in sampling of the product.





Report No.: 1369-D

## 6. References

BS EN 13501-1:2018 - Fire classification of construction products and building elements

BS EN ISO 1716:2018 - Reaction to fire tests for products — Determination of the gross heat of combustion (calorific value)

BS EN 13823:2020+A1:2022 - Reaction to fire tests for building products. Building products excluding floorings exposed to the thermal attack by a single burning item

**-End of Report-**

I2500-05

Page 10 of 10



For further information:

**T: +44 (0)3300 94 94 11**

**E: [sales@mydek.com](mailto:sales@mydek.com)**

**[mydek.com](http://mydek.com)**



## **2.0 BS EN 13823:2020+A1:2022 Test Report**

Reaction to fire tests for building products.  
Building products excluding floorings exposed  
to the thermal attack by a single burning item.



**BS EN 13823:2020+A1:2022 Test Report**

**Reaction to fire tests for building products. Building products excluding floorings exposed to the thermal attack by a single burning item.**

Date	12/02/2025
Sponsor	MyDek Ltd.
Report No	1308
Issue	A

**Disclaimer:**

- The testing method was performed in accordance with the customer's specifications.
- This report is only valid in its entirety and no part may be used independently.
- Details for the parts being examined were provided by the customer.
- Results are only valid for the specific parts examined and for the date of examination.
- The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.
- The accreditation symbol is only valid for the specific testing methods under accreditation.
- UKAS is not responsible for the results contained in this report.

Issue	Date	Notes
A	12/02/2025	First issue

The test was performed by System Laboratories UK Ltd.  
Unit 13, Apex Park, Leighton Road, Leighton Buzzard, LU7 3RE, UK



<b>Report Number</b>	<b>1308-A</b>
----------------------	---------------

<b>Purpose</b>	To determine the fire performance of the following product when tested in accordance with BS EN 13823:2020.
<b>Examination standard</b>	BS EN 13823:2020+A1:2022
<b>Examination procedure</b>	System Laboratories UK procedure I200-04
<b>Sponsor</b>	MyDek Ltd.
<b>Sponsor address</b>	11 Arkwright road, Reading, RG2 0LU, UK
<b>Manufacturer</b>	MyDek Ltd.
<b>Manufacturer's address</b>	11 Arkwright road, Reading, RG2 0LU, UK
<b>Project name</b>	Aspira Reversible Decking Board
<b>Testing location</b>	Unit 13, Apex Park, Leighton Road, Leighton Buzzard, LU7 3RE, UK
<b>Order number</b>	1308
<b>Project number</b>	444
<b>Testing date</b>	12/02/2025
<b>Report date</b>	12/02/2025
<b>Testing equipment</b>	FTT SBI Assembly [35]
<b>Sample description</b>	See page 3
<b>Examination results</b>	See page 3
<b>Deviations from testing standard</b>	N/A

**Written by**

Oliver Bauld

Testing Technician



**Approved by**

Asaf Gitarts

Laboratory Manager



**Report Number 1308-A**

Sample description (as provided by sponsor)	
Product name	Aspira Reversible Decking Board
Construction form	Aluminium decking board
Mass p. unit area	Sponsor could not provide this information
Sample density	Sponsor could not provide this information
Thickness	20 mm
Product ID	N/A
Sample ID	N/A
Sample description	Powder coated Aspira aluminium decking 20 x 244mm reversible board mounted on 32mm BoxRail substrate

Testing description	
Arrival date	13/01/2025
Conditioning	To BS EN 13238:2010 to constant mass
Sampling date	N/A
Sampling procedure	N/A
Test face	Front-Including cover strip insert Rear- omitting cover strip insert
Method of fixing	Mechanical fixing to Proprietary BoxRail 32mm
Substrate	Proprietary BoxRail 32mm
Type of joints	N/A
Flame retardant	N/A
Colour	Red
Method of mounting	5.2.2a) as per BS EN 13823:2020+A1:2022
Ventilation	Non-ventilated

Test results						
Test Parameter	Units	Test Number			Average	Classification Parameter
		1	2	3		
FIGRA Threshold: 0.2 MJ	[W/s]	0.0	0.0	0.0	0.00	A2/B
FIGRA Threshold: 0.4 MJ	[W/s]	0.0	0.0	0.0	0.00	N/A
THR <sub>600</sub>	[MJ]	0.1	0.0	0.0	0.02	A2/B
Lateral Flame Spread (LFS)	[Y or N]	No	No	No	No	A2/B
SMOGRA	[m <sup>2</sup> /s <sup>2</sup> ]	0.0	0.0	0.0	0.00	s1
TSP <sub>600</sub>	[m <sup>2</sup> ]	2.1	2.0	2.2	2.08	s1
Flaming Droplets ≤ 10s	[Y or N]	No	No	No	No	d0
Flaming Droplets > 10s	[Y or N]	No	No	No	No	d0
Pre-test temperature (°c)		11.3	10.5	11.3		
Post-test temperature (°c)		11.3	10.8	11.8		
Humidity (%RH)		53	55	53		
Ambient pressure (kPa)		100.695	100.737	100.713		



**Report Number**      1308-A

**Observations during test**

Test 1	
Time	Observation
0s	Start of data recording
120s	Ignition of Auxiliary Burner
300s	Ignition of main burner

Test 2	
Time	Observation
0s	Start of data recording
120s	Ignition of Auxiliary Burner
300s	Ignition of main burner


Test 3	
Time	Observation
0s	Start of data recording
120s	Ignition of Auxiliary Burner
300s	Ignition of main burner



For further information:  
**T: +44 (0)3300 94 94 11**  
**E: sales@mydek.com**  
**mydek.com**



**Report Number 1308-A**

**Graphs**

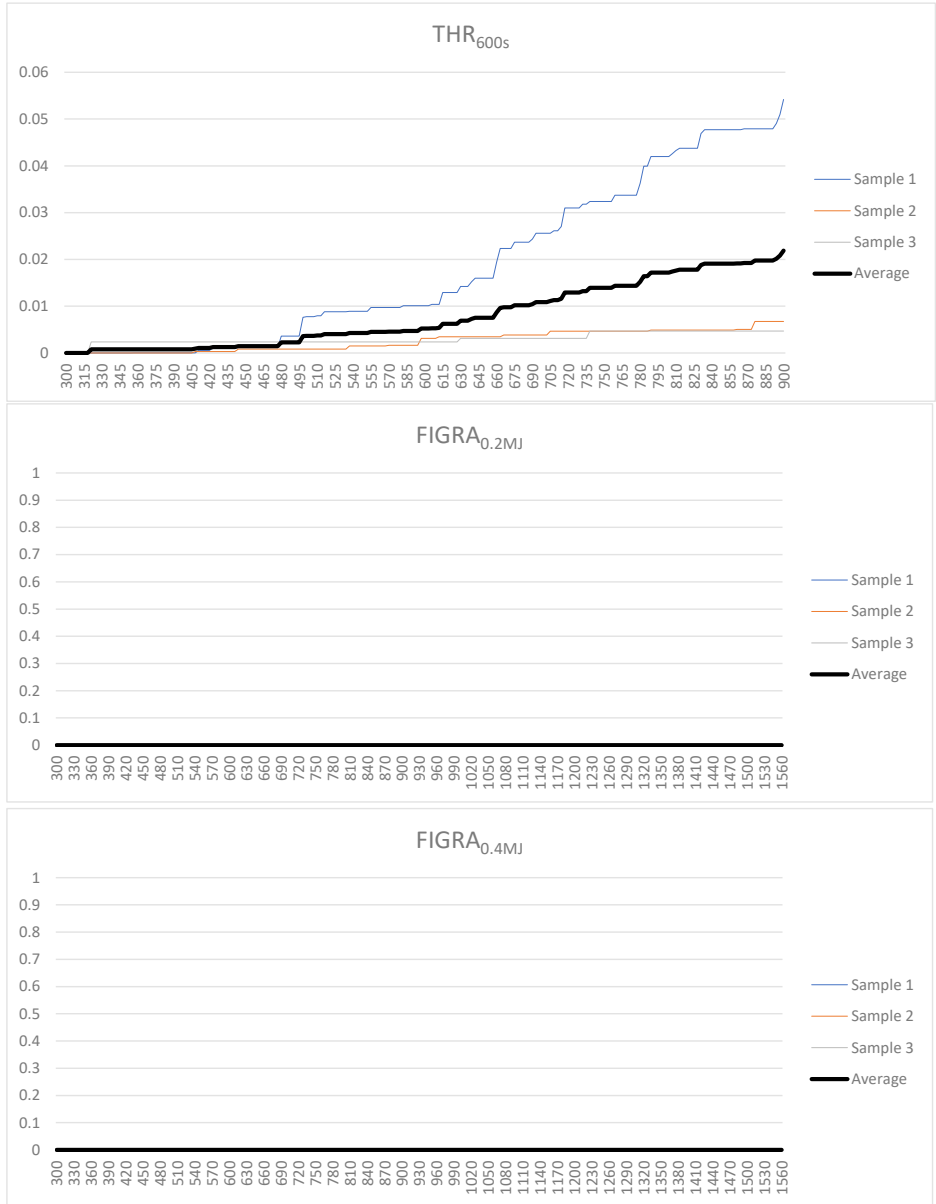

**Report Number 1308-A**

**Graphs**

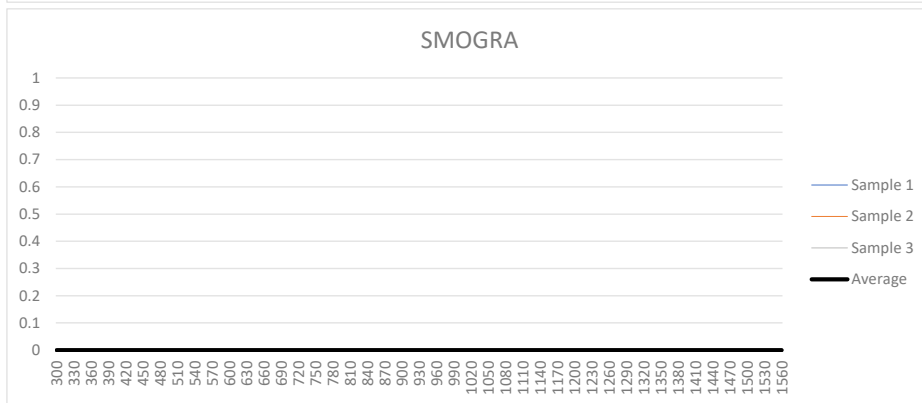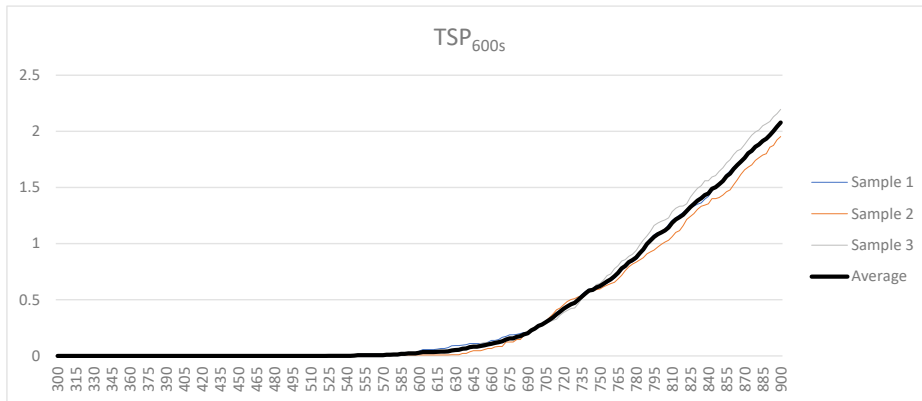

For further information:

T: +44 (0)3300 94 94 11

E: sales@mydek.com

mydek.com

**Report Number 1308-A**

**Graphs**



<b>Report Number</b>	<b>1308-A</b>
----------------------	---------------

Photographs - Sample 1



**Report Number**      1308-A

Photographs - Sample 2



<b>Report Number</b>	<b>1308-A</b>
----------------------	---------------

Photographs - Sample 3



-End of Report-

I2000-10

Page 10 of 10




For further information:

T: +44 (0)3300 94 94 11

E: [sales@mydek.com](mailto:sales@mydek.com)

[mydek.com](http://mydek.com)

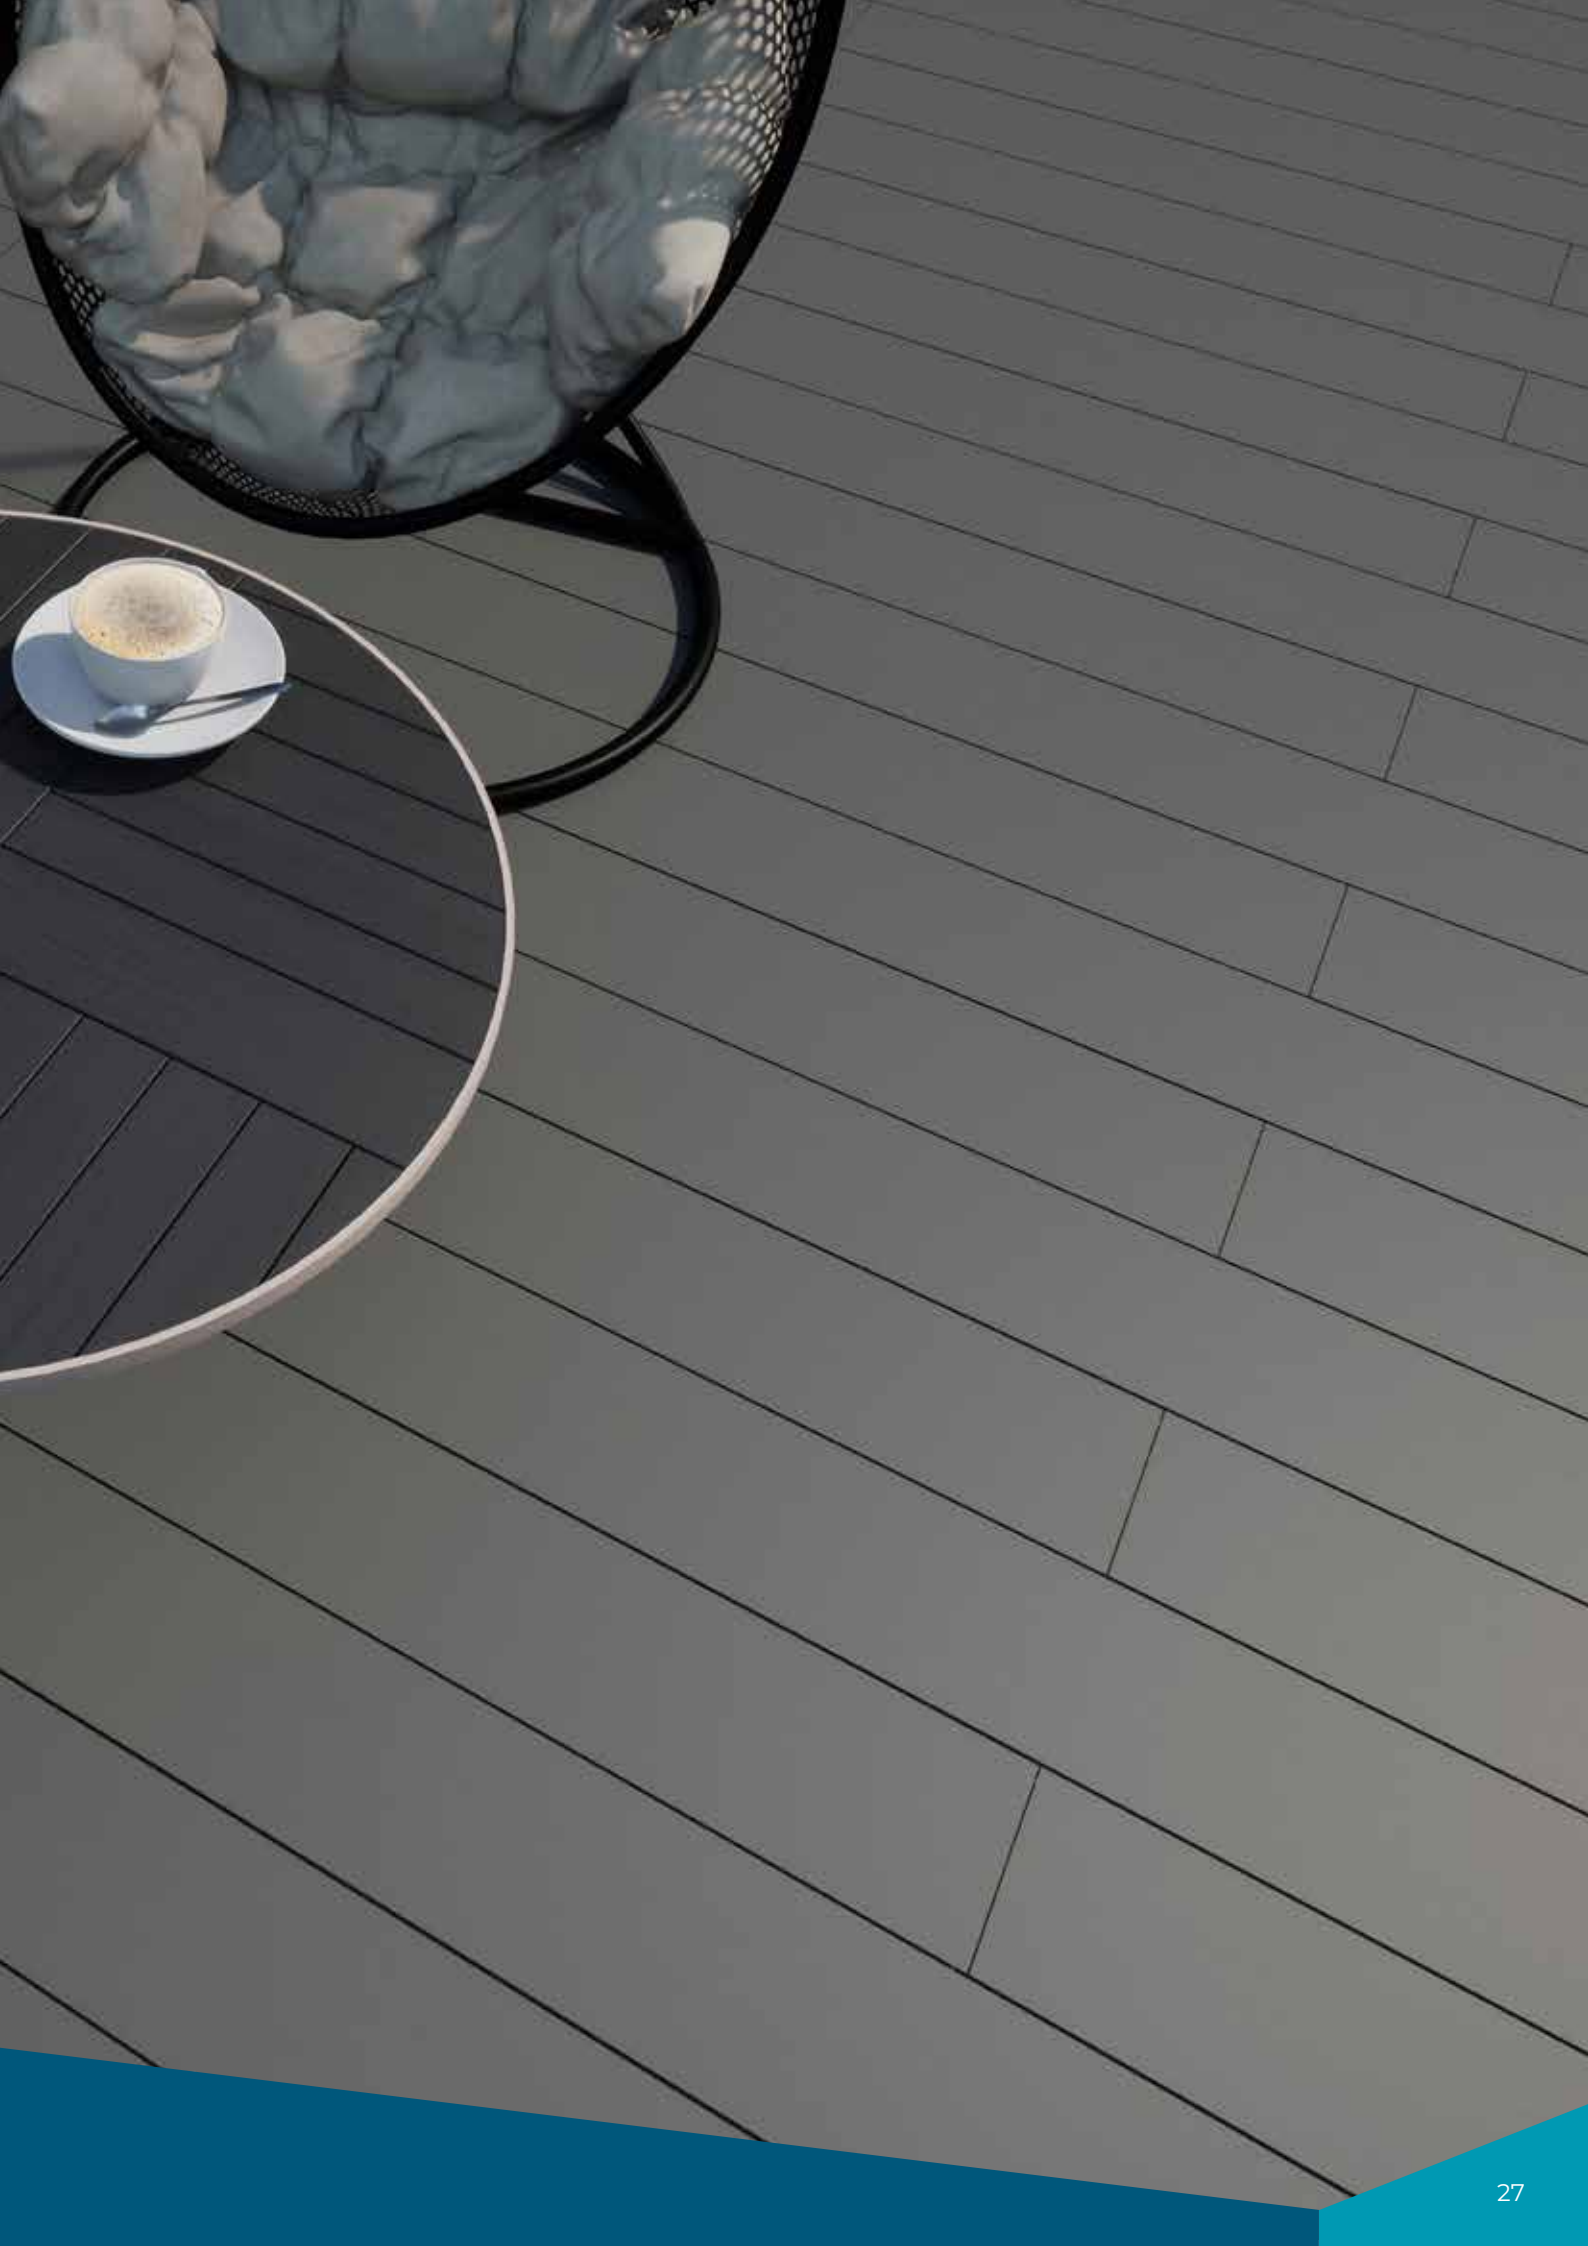

# About MyDek®

The **MyDek** team harnesses a huge range of experience, creativity, passion and drive to make balconies and terraces safe places to be. Drawn from different areas of the construction industry our team brings together extensive knowledge of specification, technical compliance and outstanding innovation to create a non-combustible decking system that delivers on our mantra of Safe. Smart. Sustainable. **So relax, you're in safe hands.**

## Safe. Smart. Sustainable.

Our ethos runs through everything we do. We're passionate to ensure that our products reflect these values and make a significant contribution to residential balconies and terraces as safe and enjoyable places.

The philosophy that supports all our products



### Safe.

- Class A2 non-combustible aluminium deck board
- Excellent slip resistance
- Durable alloy won't rust or rot
- 30 year warranty



### Smart.

- Attractive board design in range of colours
- Reversible board suitable for fixing into steel or aluminium subframe
- Wider board format reduces number of fixings required and speeds up installation



### Sustainable.

- Aluminium decking can be recycled at end of life and repurposed for further use.
- Low maintenance material gives 60 year service life.

**MYDEK®**  
Non-combustible deck systems

For further information:

**T: +44 (0)3300 94 94 11**

**E: [sales@mydek.com](mailto:sales@mydek.com)**

**[www.mydek.com](http://www.mydek.com)**